Scott. II-29—35,502—6-12-24

Law (1925) Department.
(General)

Ordinary SERIES.

G.O. No. 1752

DATED 1-6-1925

[Despatch Abstract.]

PETROLEUM.

License in Form B--Asiatic Petroleum Company, Mangalore.

INDIA COURT FEE INDIA

Asiatic Petroleum Co

TWELVE ANNAS

RAO, SUB-AGENT,

18

L. 9270 c

30/4/25

oleum Co., (India) Ltd.

MANGALORE,

REF. No.

S. CANARA COLLR'S OFFICE

No.

15 APR 1925

DATE 6 · 4 · 1925

ASSISTANT SECRETARIAT GOVERNMENT

22 APR 1925

LAW DEPARTMENT

Local. Govt
Madras

Through

The Dt. Magistrate of South Canara
Mangalore

Respected Sir

I have got a Storage license for 1000 gallons of dangerous petroleum. I request you to grant me a license for 3000 gallons. The shed is built according to the Standard plan.

For which act of kindness I am in duty bound ever pray

Forwarded
Ref. 2886 C. 25
None is in force in this District
I recommend the application. The storage shed is in order

Yours faithfully
Vellikeri Gopalrao
Sub. agent
A. P. C. Co. Ltd

D. Dt. Magistrate

To the Secretary to Government of Madras
Law (General) Dept.

2/

Law (Genl)

C No.

Memo. 2770 C-1/25/4
License

Increases quantity
Messrs. Asiatic Petroleum Co
Rangalm
Refee. D.M's Ref 2886-C-25
dt (8.4.25)

LIC

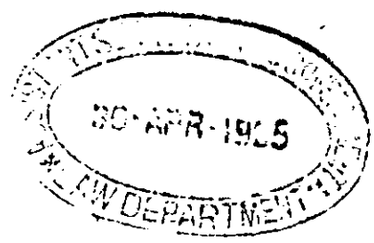

The D.M. S. Kanara is requested to obtain and forward the licence already
from
held by the Company, together with the plan of the installation.
2 Necessary
He should also collect
excess from the Company
the necessary fees and credit them
to Govt.

J.D. 27.4.25

28/4

To

The D.M. S. Kanara

30/4

30/4

PPR 27.4.25

DESPATCHED
30 APR1925

a/x one month

3

C.E. [redacted] 264—4-4-21.

LAW (GENERAL) **DEPARTMENT.**

Received ..... 192 . *Registered* ..... 192 .

Subject.

Petroleum - dangerous - License form (B) - Messrs. Asiatic Petroleum Co. Mangalore - Sub Agent N. Vyasa Rao. Government Memorandum No.2770 C-1 dated 30th April

GOVERNMENT SECRETARIAT 1925 23-MAY-1925 LAW DEPARTMENT

ENCLOSURES
No. .....
.....
Spare copies .....

Ref. No. 2886-C.25.

Station Mangalore, *Dated the* 19th May 192 5.

From (Name) G. W. Wells, Esq., M.A., I.C.S.,

(Designation) Dt. Magistrate of South Kanara.

To The Secretary to the Government of Madras,

Law (General) Department.

Stone House Hill, Cotacamund

Sir,

The license for 1000 gallons of petrol already held by the Company in the name of Mr. Nellikai Vyasa Rao together with the plan of the installation are enclo

2. An amount of Rupees Twelve (12) only havin collected from the Company at the time of the issue of th original license, which is valid till the end of the curren year, an excess of Rupees four (4) has now been collected credited to Government.

Your obedient servant,

19-5-25

Dt. Magistrate.

D[illegible]TTACHED

M.D'S.19/5. 19MAY 1925

19.5.25

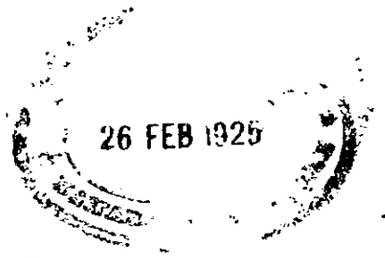

4

Pet. Act 2. MAS 4 [illegible] 224-6-11-23.

Form B.

(Rule 3 of Chapter IV of Part II.)

Licence to possess dangerous petroleum, otherwise than in bulk, in quantity exceeding (1000) One thousand ~~forty~~ gallons.

756 — C. 25

20. 2. 25

License No. 2 of 1925

Fee, Rs. Twelve (Rs 12-0-0)

Licence is hereby granted to Mr Nellikai Vyasa Rao of Mangalore for the storage, in the storage shed described below, of One thousand (1,000) gallons of dangerous petroleum, subject to the rules for the storage of petroleum published in Notification No. 441, dated 24th July 1909, and to the further conditions on the back of this licence.

This license is valid till 31st December 1925.

[signature]
Secretary to the Government of Madras, or an officer appointed by the Local Govt. in this behalf.

Mangalore
The 20. 2. 1925

21.2.25

20. 2. 25.

(Description of the storage shed above referred to.)

In the newly Constructed petrol Shed in the Garden of the licensee in Mangalore Town

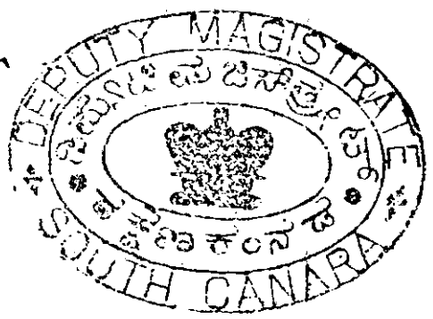

Endorsement on Form B.

CONDITIONS OF LICENCE.

1. If the licensing officer call upon the holder of a licence, by notice in writing, to execute any repairs of the storage shed, which may, in the opinion of such officer, be necessary for the safety of the shed, the holder of the licence shall execute the repairs within such period, not being less than one month from the date of receipt of the notice, as may be fixed by the notice.

2. The licence-holder is prohibited from delivering any quantity of dangerous petroleum exceeding three gallons to any one who has not a licence under section 5 or section 6 of the Act, or any less quantity of such petroleum, except in accordance with the conditions of the proviso to section 6 of the Act, as to the vessels in which the petroleum must be contained.

3. The petroleum shall be stored in gas-tight tinned or galvanized sheet iron, steel, or lead plate receptacles containing each not more than sixty-five gallons and fitted with well-made filling holes and well-fitting screw plugs, or fitted with screw cap or other cap with metal air-tight undercap. Such receptacles shall be packed in strong wooden cases, the thickness of the wood to be not less than three-eighths of an inch; provided that wood cases shall not be necessary when the receptacles are made of tinned or galvanized sheet iron or steel, and have the following thickness of metal:—

	Not less than
(1) When the capacity does not exceed two gallons ...	27 B.W.G.
(2) When the capacity exceeds two gallons but does not exceed four gallons	22 B.W.G.
(3) When the capacity exceeds four gallons but does not exceed eight gallons	20 B.W.G.
(4) When the capacity exceeds eight gallons but does not exceed twenty gallons	16 B.W.G.
(5) When the capacity exceeds twenty gallons but does not exceed thirty gallons	14 B.W.G.
(6) When the capacity exceeds thirty gallons but does not exceed forty gallons	12 B.W.G.
(7) When the capacity exceeds forty gallons but does not exceed sixty-five gallons	10 B.W.G.

4. An air-space of at least one-tenth of its capacity shall be left in each receptacle at the time of filling.

5. The receptacle shall be so substantially constructed and secured as not to be liable, except under circumstances of grave negligence or extraordinary accident, to be broken or become defective, leaky or insecure.

6. The receptacles shall be labelled in accordance with the provisions of section 7 of the Act.

7. Any receptacles, before being repaired, shall be cleared of all dangerous petroleum and of all dangerous vapours arising from the same.

8. The storage shed shall be constructed of masonry or other uninflammable material with terraced, tiled or iron roofs and with tiled or paved or earthen floors.

9. Either the doorways and other openings of the storage shed shall be built up to a height of two feet above the level of the road or street, or the floor sunk to a depth of two feet below the level of the road or street, so that the petroleum cannot flow out from the building in case of its escape from the receptacle in which it is contained, or the building itself shall be surrounded with a masonry wall or embankment or both not less than two feet high. When the quantity of petroleum stored exceeds 16,000 gallons the height or depth shall be three feet.

A combination of these methods is permissible.

10. All ventilating openings in the storage shed shall be protected by strong wire gauze.

11. No light, except a light of such strength, position and character as is not liable to ignite any inflammable vapour, nor fire of any description, shall be permitted at any time within the storage shed.

12. All due precautions shall be taken for the prevention of unauthorized persons having access to any dangerous petroleum kept and to the vessels containing or having actually contained the same.

13. Every person managing or employed on or in connexion with the storage shed shall abstain from any act whatever which tends to cause fire or explosion and which is not reasonably necessary, and shall prevent any other person from doing such act.

14. The drum or other receptacle containing dangerous petroleum shall only be opened on the licensed premises at or immediately adjoining the storage shed and for the time necessary for drawing off the petroleum, and during such drawing off every reasonable precaution shall be adopted for preventing the escape of dangerous petroleum or the vapour therefrom.

15. The following distances shall be kept clear from protected works round the storage shed :—

Quantity to be stored.	Distances to be kept clear.
Not exceeding 500 gallons	20 feet.
From 500 to 1,000 „	25 „
„ 1,000 to 5,000 „	30 „
„ 5,000 to 15,000 „	40 „
„ 15,000 to 25,000 „	50 „
„ 25,000 to 35,000 „	60 „
„ 35,000 to 50,000 „	70 „
„ 50,000 gallons and over	100 „

Provided that these distances may be reduced by the licensing authority on the recommendation of the Chief Inspector of Explosives in cases where screen walls are provided, or other special precautions taken, or where there are special circumstances that in the opinion of the Chief Inspector of Explosives warrant the reduction.

16. Provided that when the quantity to be possessed does not exceed 60 gallons the provisions of conditions 8, 9 and 15 shall not apply, but the licensee shall observe the following conditions :—

(i) The storage shed in which the dangerous petroleum is stored shall be well ventilated and constructed of uninflammable material, provided however that the doors and windows may be of wood.

(ii) Where a storage shed forms part of or is attached to another building and when the intervening floor or partition is of an unsubstantial or inflammable character or has openings therein, the whole of such building shall be deemed to be the storage shed and no portion of such storage shed shall be used as a dwelling house or as a place where persons assemble. The storage shed shall have a separate entrance from the open air distinct from any building or dwelling in which persons assemble.

17. The storage shed shall be liable to inspection by an officer not being of lower rank than a Sub-Inspector of Police authorized by the Governor in Council in this behalf.

Sectt. 11-5 (a)—28,703—8-12-24. (6)

Law (Jud.) DEPARTMENT

	Date.	Initials.
When received for Fair-copying.		
When copied		
When examined	1/6	
When signed		
When despatched		

Petroleum.

License in form B. Asiatic Petroleum Coy - Mangalore

READ AGAIN G.O. No. , dated 192

" " 192

READ ALSO:—

C. No. 2776 C From the D. M. S. Kanara No. 2886 C dated 17 4 1925

3120 C 15. 5 1925

192

ORDER. No 1752 dated 1 6 1925

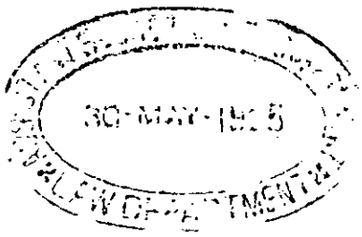

DESPATCHED

4 JUN 1925

To

The D. M S Kanara
(with license)

The C. I of Explosives
(with copy of license)

A license in form B. of the Petroleum Rules will be issued to M Rg Nellivai Vyasa Rao, Sub agent to the Asiatic Petroleum ~~Co~~ (India) Ltd, Mangalore, for the storage of 3000 (three thousand) gallons of dangerous petroleum in the newly constructed petrol shed in the garden of the licensee in Mangalore town, S Kanara D.t it will be forwarded to the D.M S. Kanara for delivery to the applicant

1182
26-8-25 BR

Sectt. II-5 (a)—28,703—8-12-21. (6)

Law (Genl) DEPARTMENT

	Date.	Initials.
When received for Fair-copying.		
When copied	1/6	
When examined	1/6	
When signed		
When despatched		

Petroleum.

License in form B. Asiatic Petroleum Coy - Mangalore

READ AGAIN G.O. No. , dated 192

192

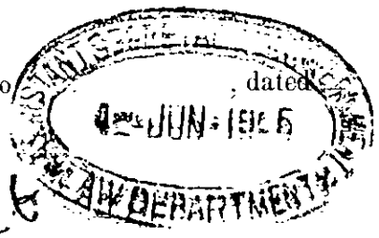

READ ALSO:—

C. No. 2776 C From the D. M S. Kanara. No. 2886 C dated 17 4 1925

3120 C 15. 5 1925

192

ORDER No 1752 dated 1 6 1925

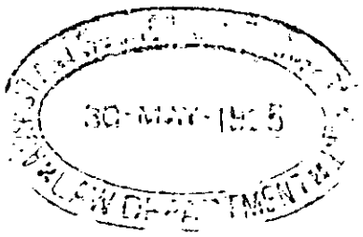

A license in form B. of the Petroleum Rules will be issued to M Ry Nellivai Vyasa Rao Sub agent to the Asiatic Petroleum ~~Co~~ (India) Ltd Mangalore, for the storage of 3000 (three thousand) gallons of dangerous petroleum in the newly constructed petrol shed in the garden of the licensee in Mangalore town, S. Kanara Dt. It will be forwarded to the D.M, S. Kanara for delivery to the applicant

DESPATCHED
JUN1925

To
The D M S. Kanara
(with license)
The C.I of Explosives
(with Copy of license)

26-8

Mis. Form No. 84.
600 copies—24-4-1918.

Form B

(*Rule 3 of Chapter IV of Part II*)

License to possess dangerous Petroleum, otherwise than in bulk, in quantity exceeding forty gallons for the year ending 31st December 1925

No Fee Rs. 16/-

License is hereby granted to M.R.R. Nellwar Vyasa Rao of Mangalore Town

for the storage in the storage, shed described below, of 3000 (three thousand)

gallons of dangerous Petroleum, subject to the Rules for the Storage of Petroleum published in Notification No. 441, dated 24th July 1909, and to the further conditions on the back of this license. The license shall have effect from 1st January 1925 to 31st December 1925

Fort St George

The May 19

V.T. 5/9

~~*President,*~~
~~*Corporation of Madras.*~~
o/c Secy to Govt Law Dept.

(Description of the storage shed above referred to).

In the newly constructed petrol shed in the garden of the licensee in Mangalore town

PRR 2/5

Endorsement on Form B

CONDITIONS OF LICENSE.

1. If the licensing officer call upon the holder of a license, by notice in writing, to execute any repairs of the storage shed, which may, in the opinion of such officer, be necessary for the safety of the shed, the holder of the license shall execute the repairs within such period, not being less than one month from the date of receipt of the notice, as may be fixed by the notice.

2. The license-holder is prohibited from delivering any quantity of dangerous petroleum exceeding three gallons to any one who has not a license under section 5 or section 6 of the Act, or any less quantity of such petroleum, except in accordance with the conditions of the proviso to section 6 of the Act, as to the vessels in which the petroleum must be contained.

3. The petroleum shall be stored in gas-tight tinned or galvanized sheet iron, steel, or lead plate receptacles containing each not more than sixty five gallons and fitted with well-made filling holes and well-fitting screw plugs, or fitted with screw cap or other cap with metal air-tight undercap. Such receptacles shall be packed in strong wooden cases, the thickness of the wood to be not less than three-eighths of an inch; provided that wood cases shall not be necessary when the receptacles are made of tinned or galvanized sheet iron or steel, and have the following thickness of metal :—

	Not less than
(1) When the capacity does not exceed two gallons	27 B.W.G.
(2) When the capacity exceeds two gallons but does not exceed four gallons	22 B.W.G
(3) When the capacity exceeds four gallons but does not exceed eight gallons	20 B.W.G.
(4) When the capacity exceeds eight gallons but does not exceed twenty gallons	16 B.W.G
(5) When the capacity exceeds twenty but does not exceed thirty gallons ...	14 B.W.G.
(6) When the capacity exceeds thirty but does not exceed forty gallons ...	12 B.W.G·
(7) When the capacity exceeds forty but does not exceed sixty five gallons	12 B.W.G.

4. An air-space of at least one-tenth of its capacity shall be left in each receptacle at the time of filling.

5. The receptacle shall be so substantially constructed and secured as not to be liable, except under circumstances of grave negligence or extraordinary accident, to be broken or become defective, leaky or insecure.

6. The receptacles shall be labelled in accordance with the provisions of section 7 of the Act.

7. Any receptacle, before being repaired, shall be cleared of all dangerous petroleum and of all dangerous vapours arising from the same.

8. The storage shed shall be constructed of masonry or other uninflammable material with terraced, tiled or iron roofs and with tiled or paved or earthen floors.

9. Either the doorways and other openings of the storage shed shall be built up to a height of two feet above the level of the road or street, or the floor sunk to a depth of two feet below the level of the road or street, so that the petroleum cannot flow out from the building in case of its escape from the receptacle in which it is contained, or the building itself shall be surrounded with a masonry wall or embankment or both not less than two feet high. When the quantity of petroleum stored exceeds 16,000 gallons the height or depth shall be three feet.

A combination of these methods is permissible.

10. All ventilating openings in the storage shed shall be protected by strong wire gauze.

11. No light, except a light of such strength, position and character as is not liable to ignite any inflammable vapour, nor fire of any description, shall be permitted at any time within the storage shed.

12. All due precautions shall be taken for the prevention of unauthorized persons having access to any dangerous petroleum kept and to the vessels containing or having actually contained the same.

13. Every person managing or employed on or in connection with the storage shed shall abstain from any act whatever which tends to cause fire or explosion and which is not reasonably necessary, and shall prevent any other person from doing such act.

14. The drum or other receptacle containing dangerous petroleum shall only be opened on the licensed premises at or immediately adjoining the storage shed and for the time necessary for drawing off the petroleum and during such drawing off every reasonable precaution shall be adopted for preventing the escape of dangerous petroleum or the vapour therefrom.

15. The following distances shall be kept clear from protected works round the storage shed :—

Quantity to be stored.	*Distances to be kept clear.*
Not exceeding 500 gallons	20 feet.
From 500 to 1,000 „	25 „
„ 1,000 to 5,000 „	30 „
„ 5,000 to 15,000 „	40 „
„ 15,000 to 25,000 „	50 „
„ 25,000 to 35,000 „	60 „
„ 35,000 to 50,000 „	70 „
„ 50,000 and over „	100 „

Provided that these distances may be reduced by the Licensing authority on the recommendation of the Chief Inspector of Explosives in cases where screen walls are provided or other special precautions taken, or where there are special circumstances that in the opinion of the Chief Inspector of Explosives warrant the reduction.

16. Provided that when the quantity to be possessed does not exceed 60 gallons the provisions of conditions 8, 9 and 15 shall not apply, but the licensee shall observe the following conditions

(i) The storage shed in which the dangerous petroleum is stored shall be well ventilated and constructed of uninflammable material, provided, however, that the doors and windows may be of wood.

(ii) Where a storage shed forms part of, or is attached to, another building and when the intervening floor or partition is of an unsubstantial or inflammable character or has openings therein, the whole of such building shall be deemed to be the storage shed and no portion of such storage shed shall be used as a dwelling house or as a place where persons assemble. The storage shed shall have a separate entrance from the open air distinct from any building or dwelling in which persons assemble.

17. The storage shed shall be liable to inspection by an officer not being of lower rank than a Sub-Inspector of Police authorised by the Governor-in-Council in this behalf

Note.—Round all licensed installations the following spaces must be kept clear in all directions, *viz* :—

Major installations (irrespective of the quantity stored) ...	150 feet.
Minor installations up to 5,000 gallons	15 feet.
20,000 gallons	20 feet.
50,000 gallons	30 feet.

ANANDA PRESS, MADRAS.